


Figure 4.2: Routeing Considerations

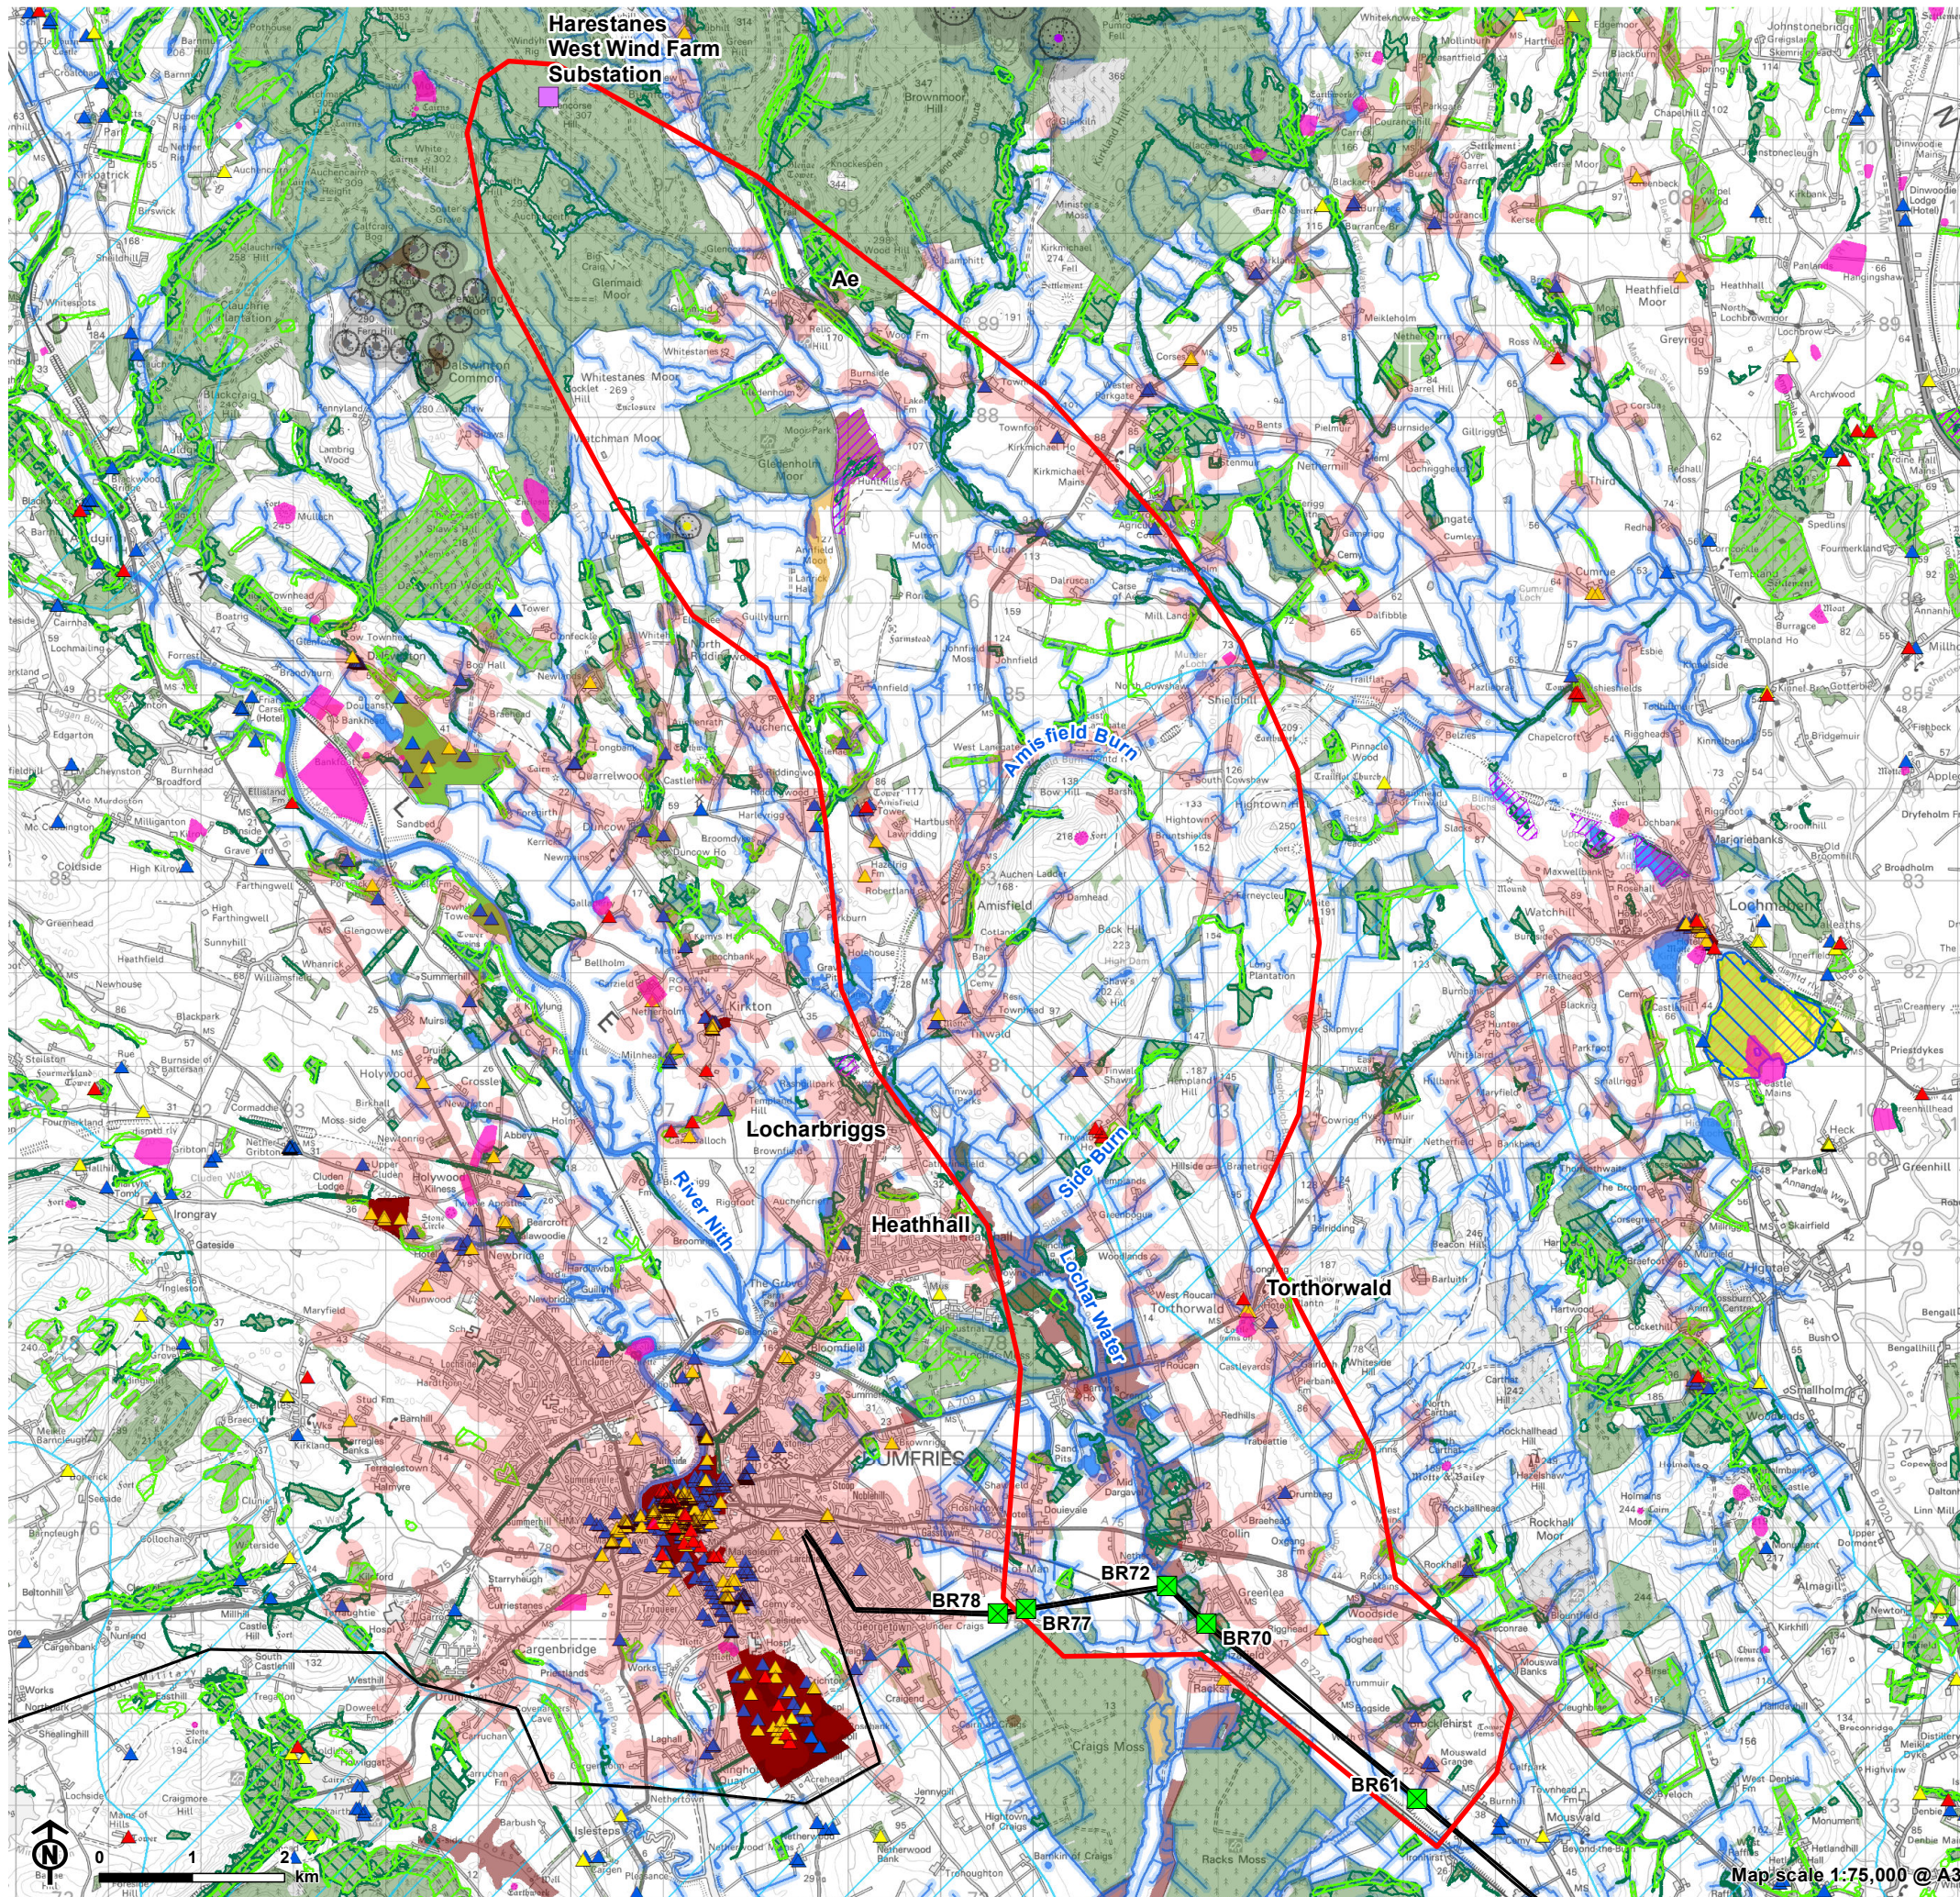

- Study Area
- Point of Connection
- Tension Towers for Connection
- Existing 132kV overhead line (OHL)
- Wind Turbine - Operational
- Wind Turbine - Application Submitted
- Wind Turbine - Design/Scoping
- Wind Turbine - Rotor Diameter x 3
- Wind Turbine - Tip Height + 10%
- 150m from residential address
- Conservation Area
- Scheduled Monument
- Listed Building - Category A
- Listed Building - Category B
- Listed Building - Category C
- Gardens and Designed Landscape
- DGC - Regional Scenic Area
- Special Protection Area (SPA)
- Ramsar site
- Site of Special Scientific Interest (SSSI)
- Ancient Woodland Inventory (AWI)
- Native Woodland Survey of Scotland 2014
- National Forest Inventory
- SNH Carbon Peatland - Category 1
- SNH Carbon Peatland - Category 2
- Watercourse
- Watercourse - 50m buffer