


Figure 6.1: Preferred Route

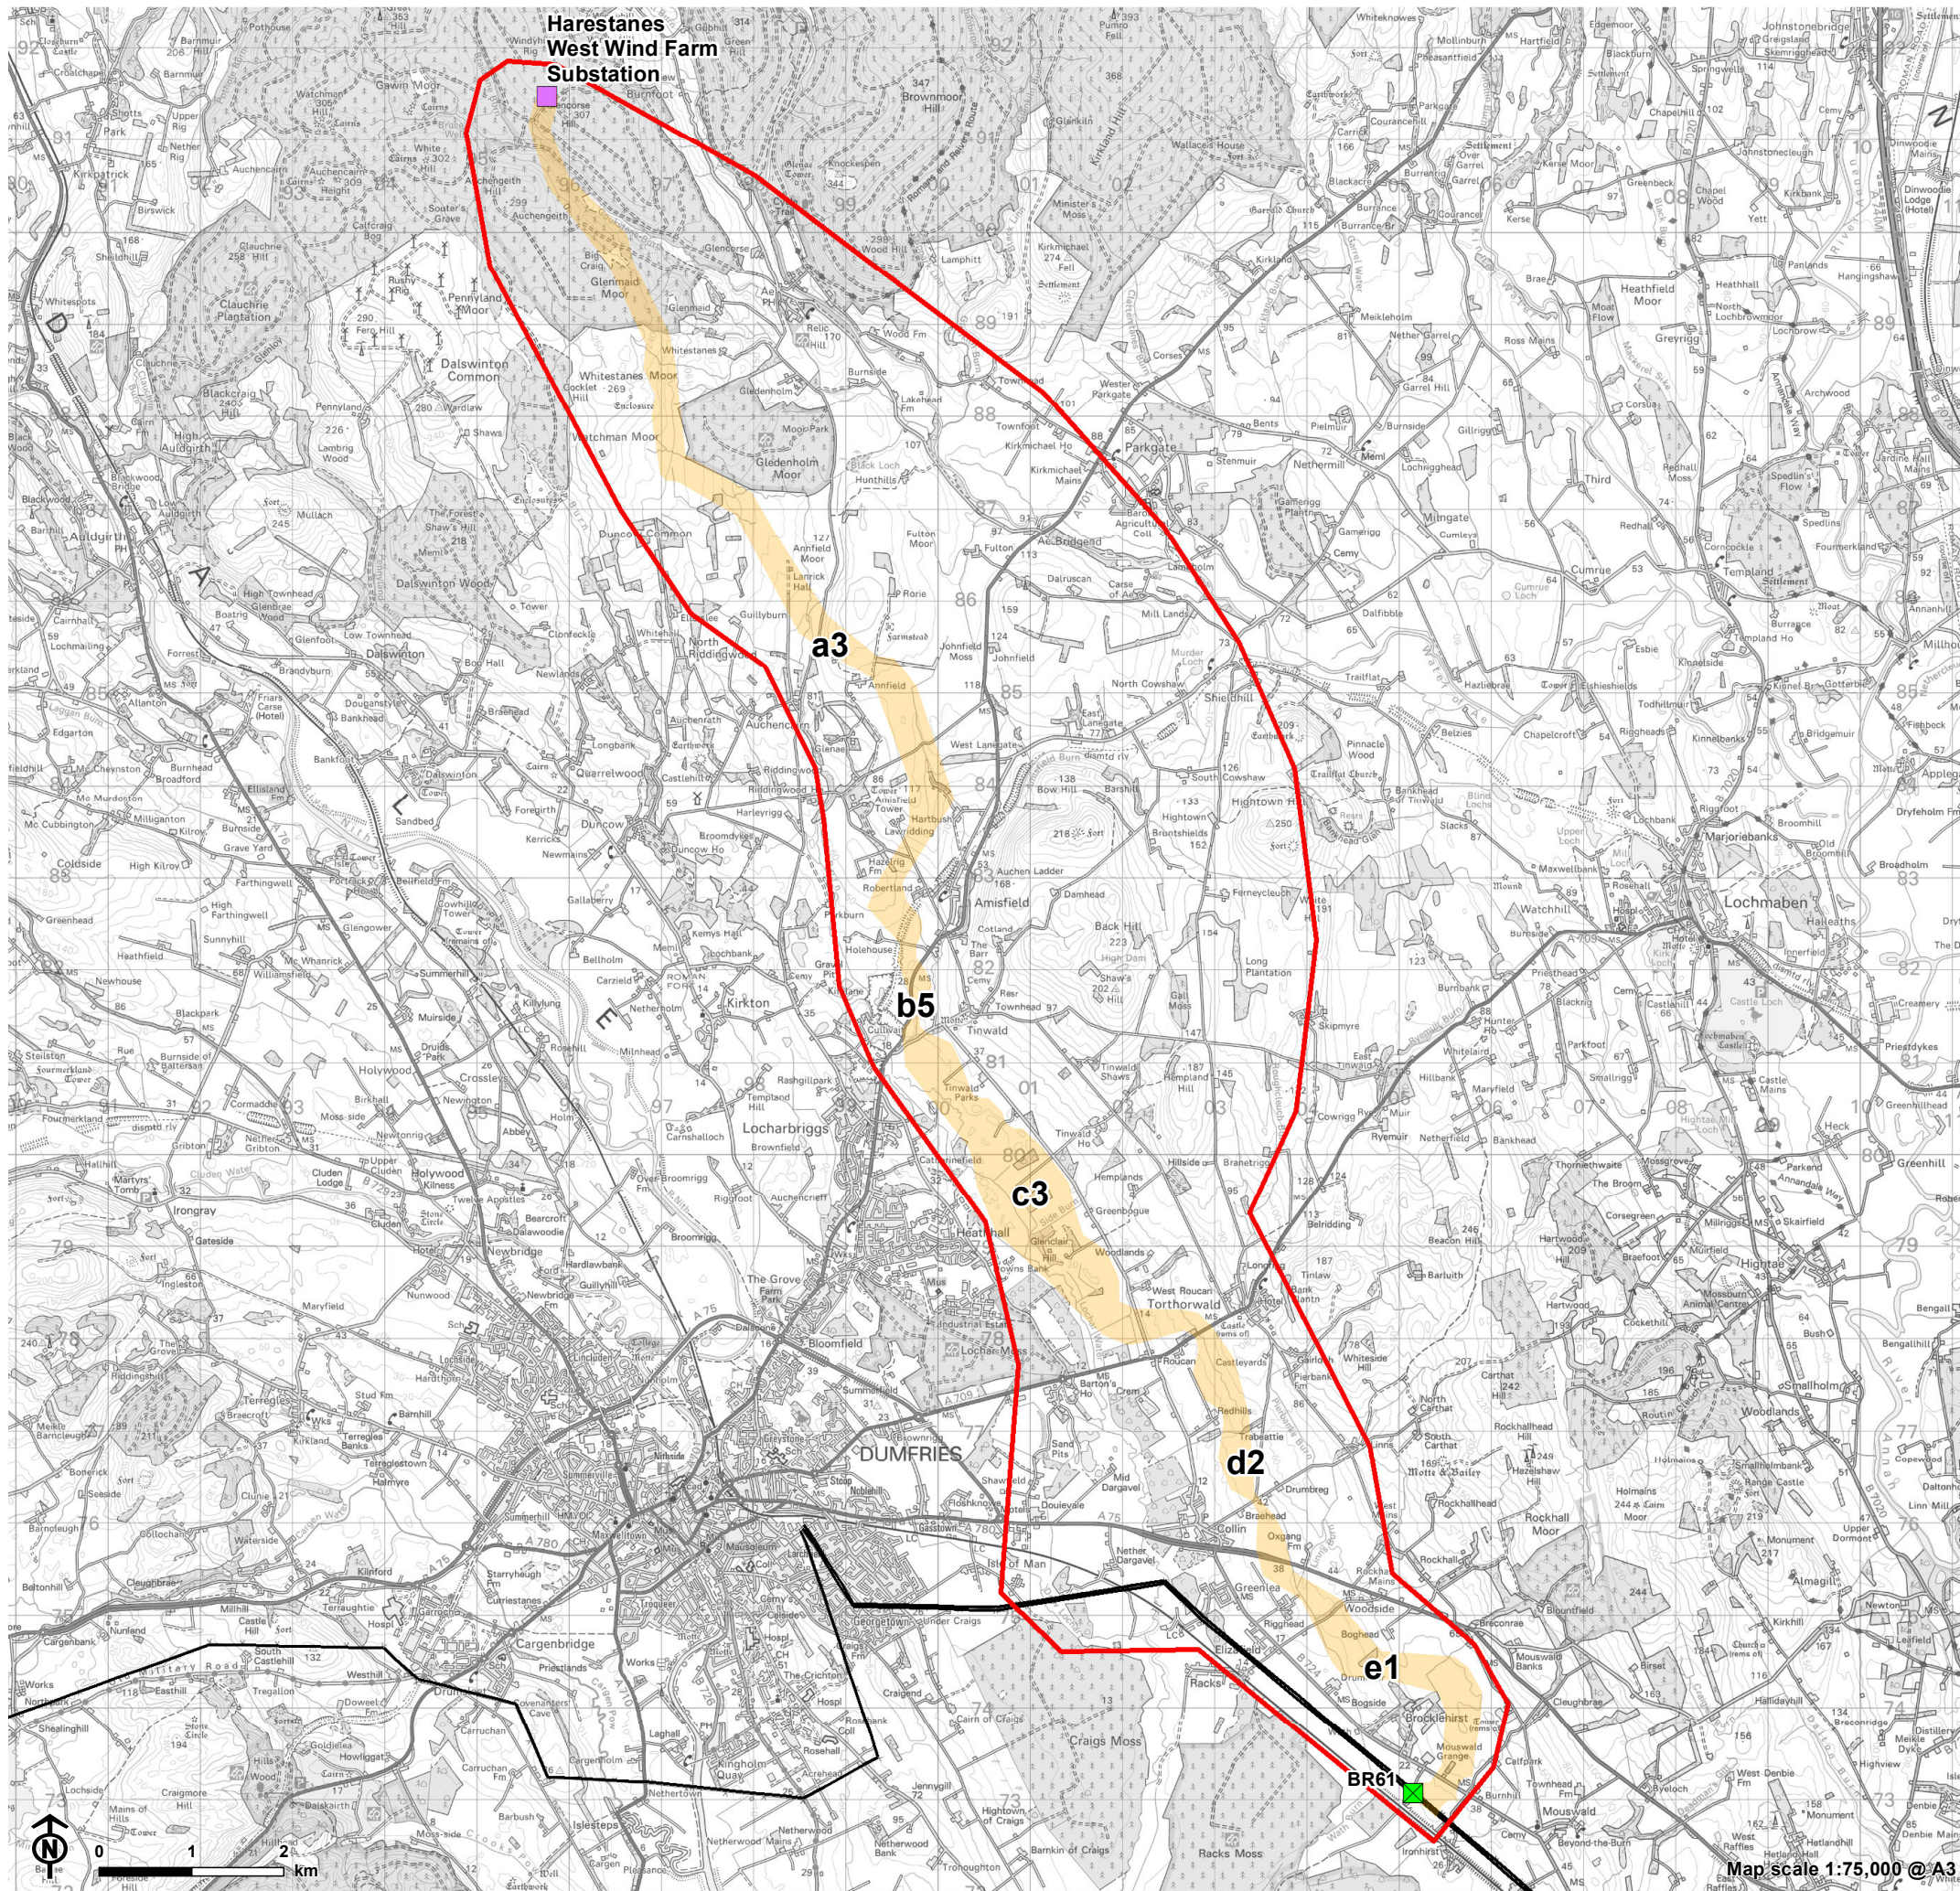

- Study Area
- Point of Connection
- Tension Towers for Connection
- Preferred Route
- Existing 132kV overhead line (OHL)